


Notes:

1. Side sewers that will not be reused shall be abandoned permanently at the main and capped with an approved watertight, gasketed cap.
2. Side sewers that will be reused shall be abandoned temporarily with an approved watertight, gasketed cap at the end of the 6" stub at the property line and install 2"x4" marker.
3. Paint portion of Service Marker that is above grade with white paint. Stencil "S/S" with 3" tall black letters.

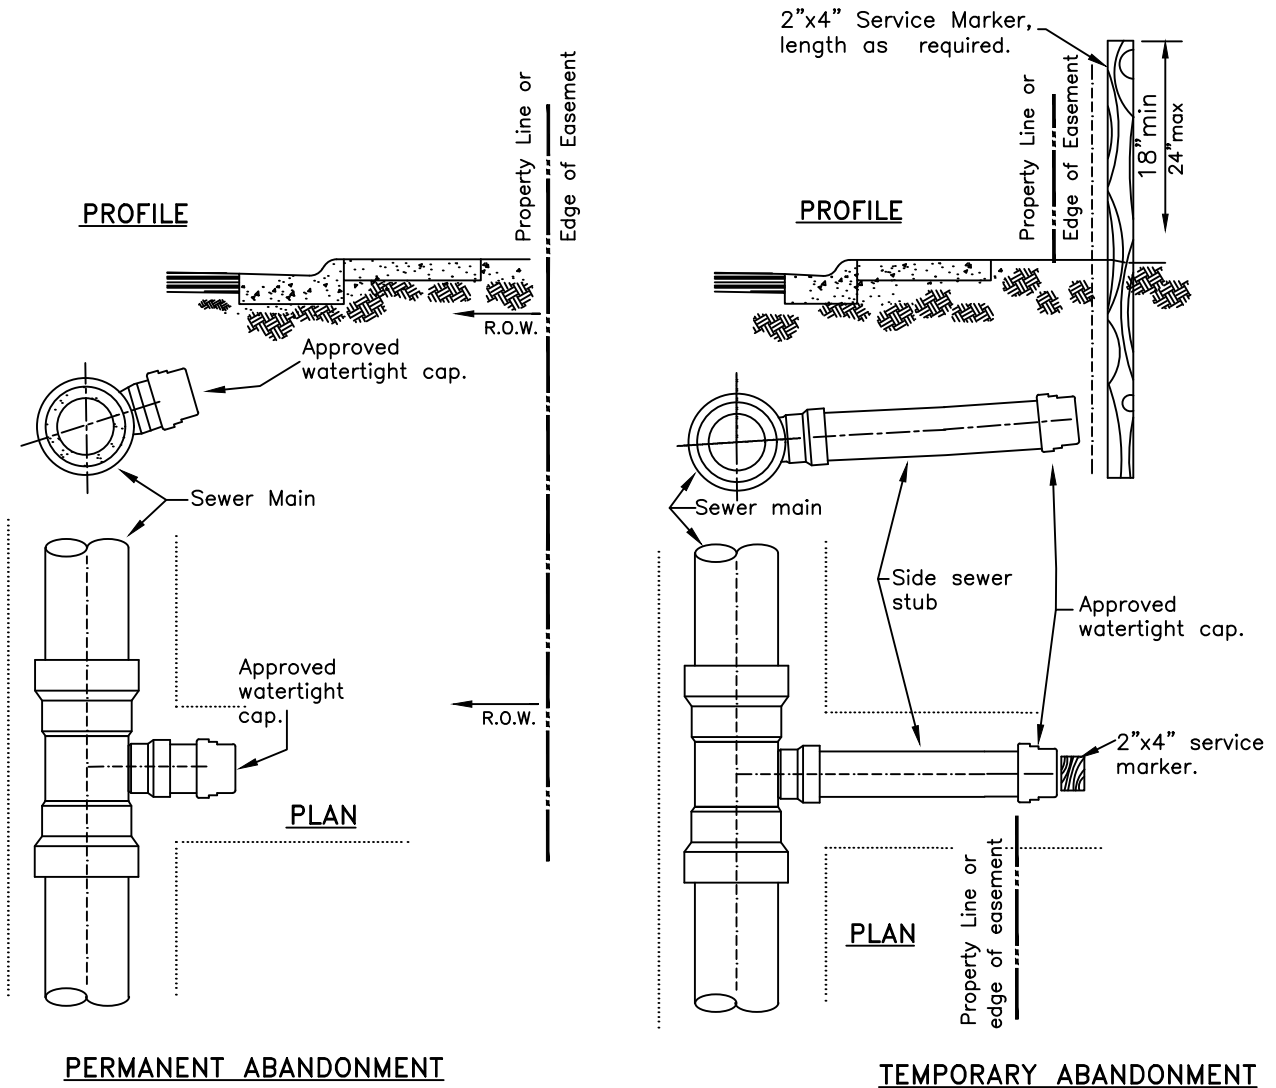

SIDE SEWER CAPPING

NOT TO SCALE

Detail Approvals
 Engineer GSM
 Manager DPK

**NORTHSHORE UTILITY DISTRICT
 STANDARD SEWER DETAILS**

8c

June 2016
 S-15(SEWERCAPPING).dwg