



CLEANOUT BOX

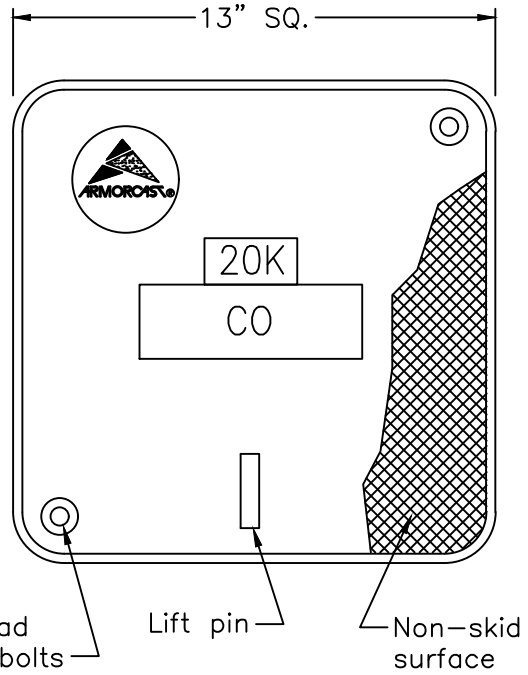

CLEANOUT COVER

Notes:

1. Surface Cleanouts required at the building connection in hardscape and every 100 feet. The side sewer connection at the main line stub shall be a two-way cleanout test tee. See Standard Details 7 & 8a.
2. Cleanout box and cover shall be Armorcast Polymer Concrete Box Assembly, part #A6001423TA, H20 rated with Pentahead locking bolts and "CO" stamped on cover. All cleanouts brought to grade shall have this box and cover installed.
3. All pipe material shall be bell & spigot type with rubber gasket joint and shall be in conformance with ASTM D3034 (SDR-35).

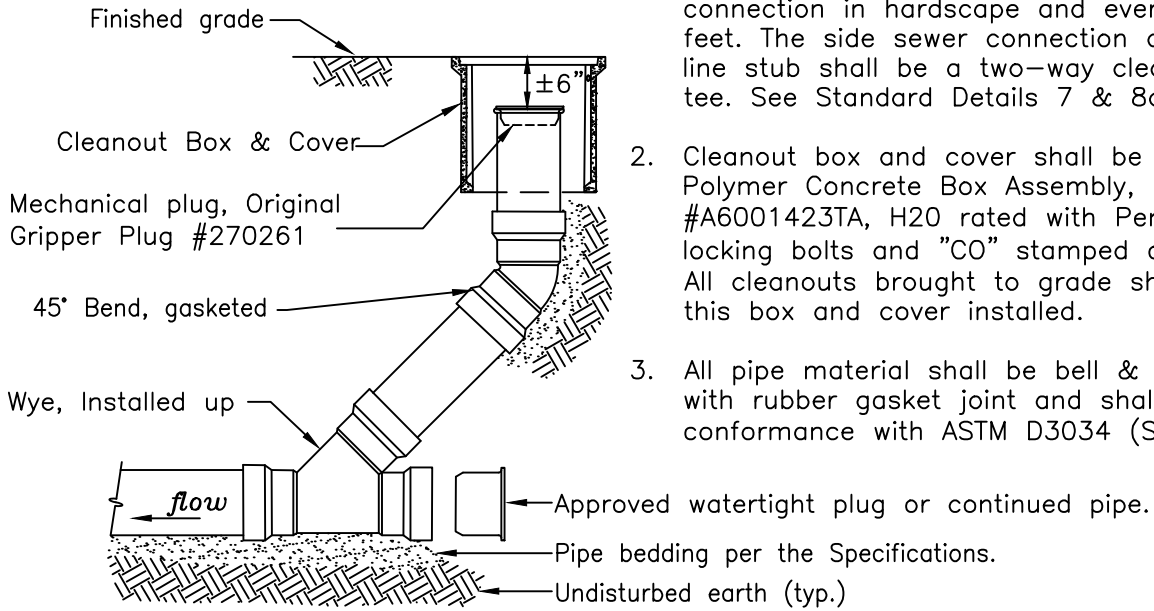

PROFILE

**SIDE SEWER
SURFACE CLEANOUT**

NOT TO SCALE

Detail Approvals
 Engineer GSM
 Manager DPK

**NORTHSHORE UTILITY DISTRICT
 STANDARD SEWER DETAILS**

9

June 2015
 S-9(CLEANOUT).dwg